

2/2/2015 5:00:57 PM

C:\Revit Local Files\074823_MEP_Central_2014_wetzel.rvt

<



LWC

INCORPORATED

434 East First Street Dayton, OH 45402 937.223.6500

4440 Garwood Place Richmond, IN 47374 765.966.3546



DAYTON INTERNATIONAL AIRPORT

3600 TERMINAL DRIVE VANADALIA, OH 45377

(937) 454-8209

PHASE 1 - CANOPY

RENOVATION


3600 TERMINAL DRIVE

PROGRESS
DRAWING
NOT FOR
CONSTRUCTION
2/2/2015
5:00:57 PM

Comm. No. 14613.00

Drawn

C:\Revit Local Files\074823_MEP_Central_2014_wetzel.rvt 22/2015 5:01:08 PM

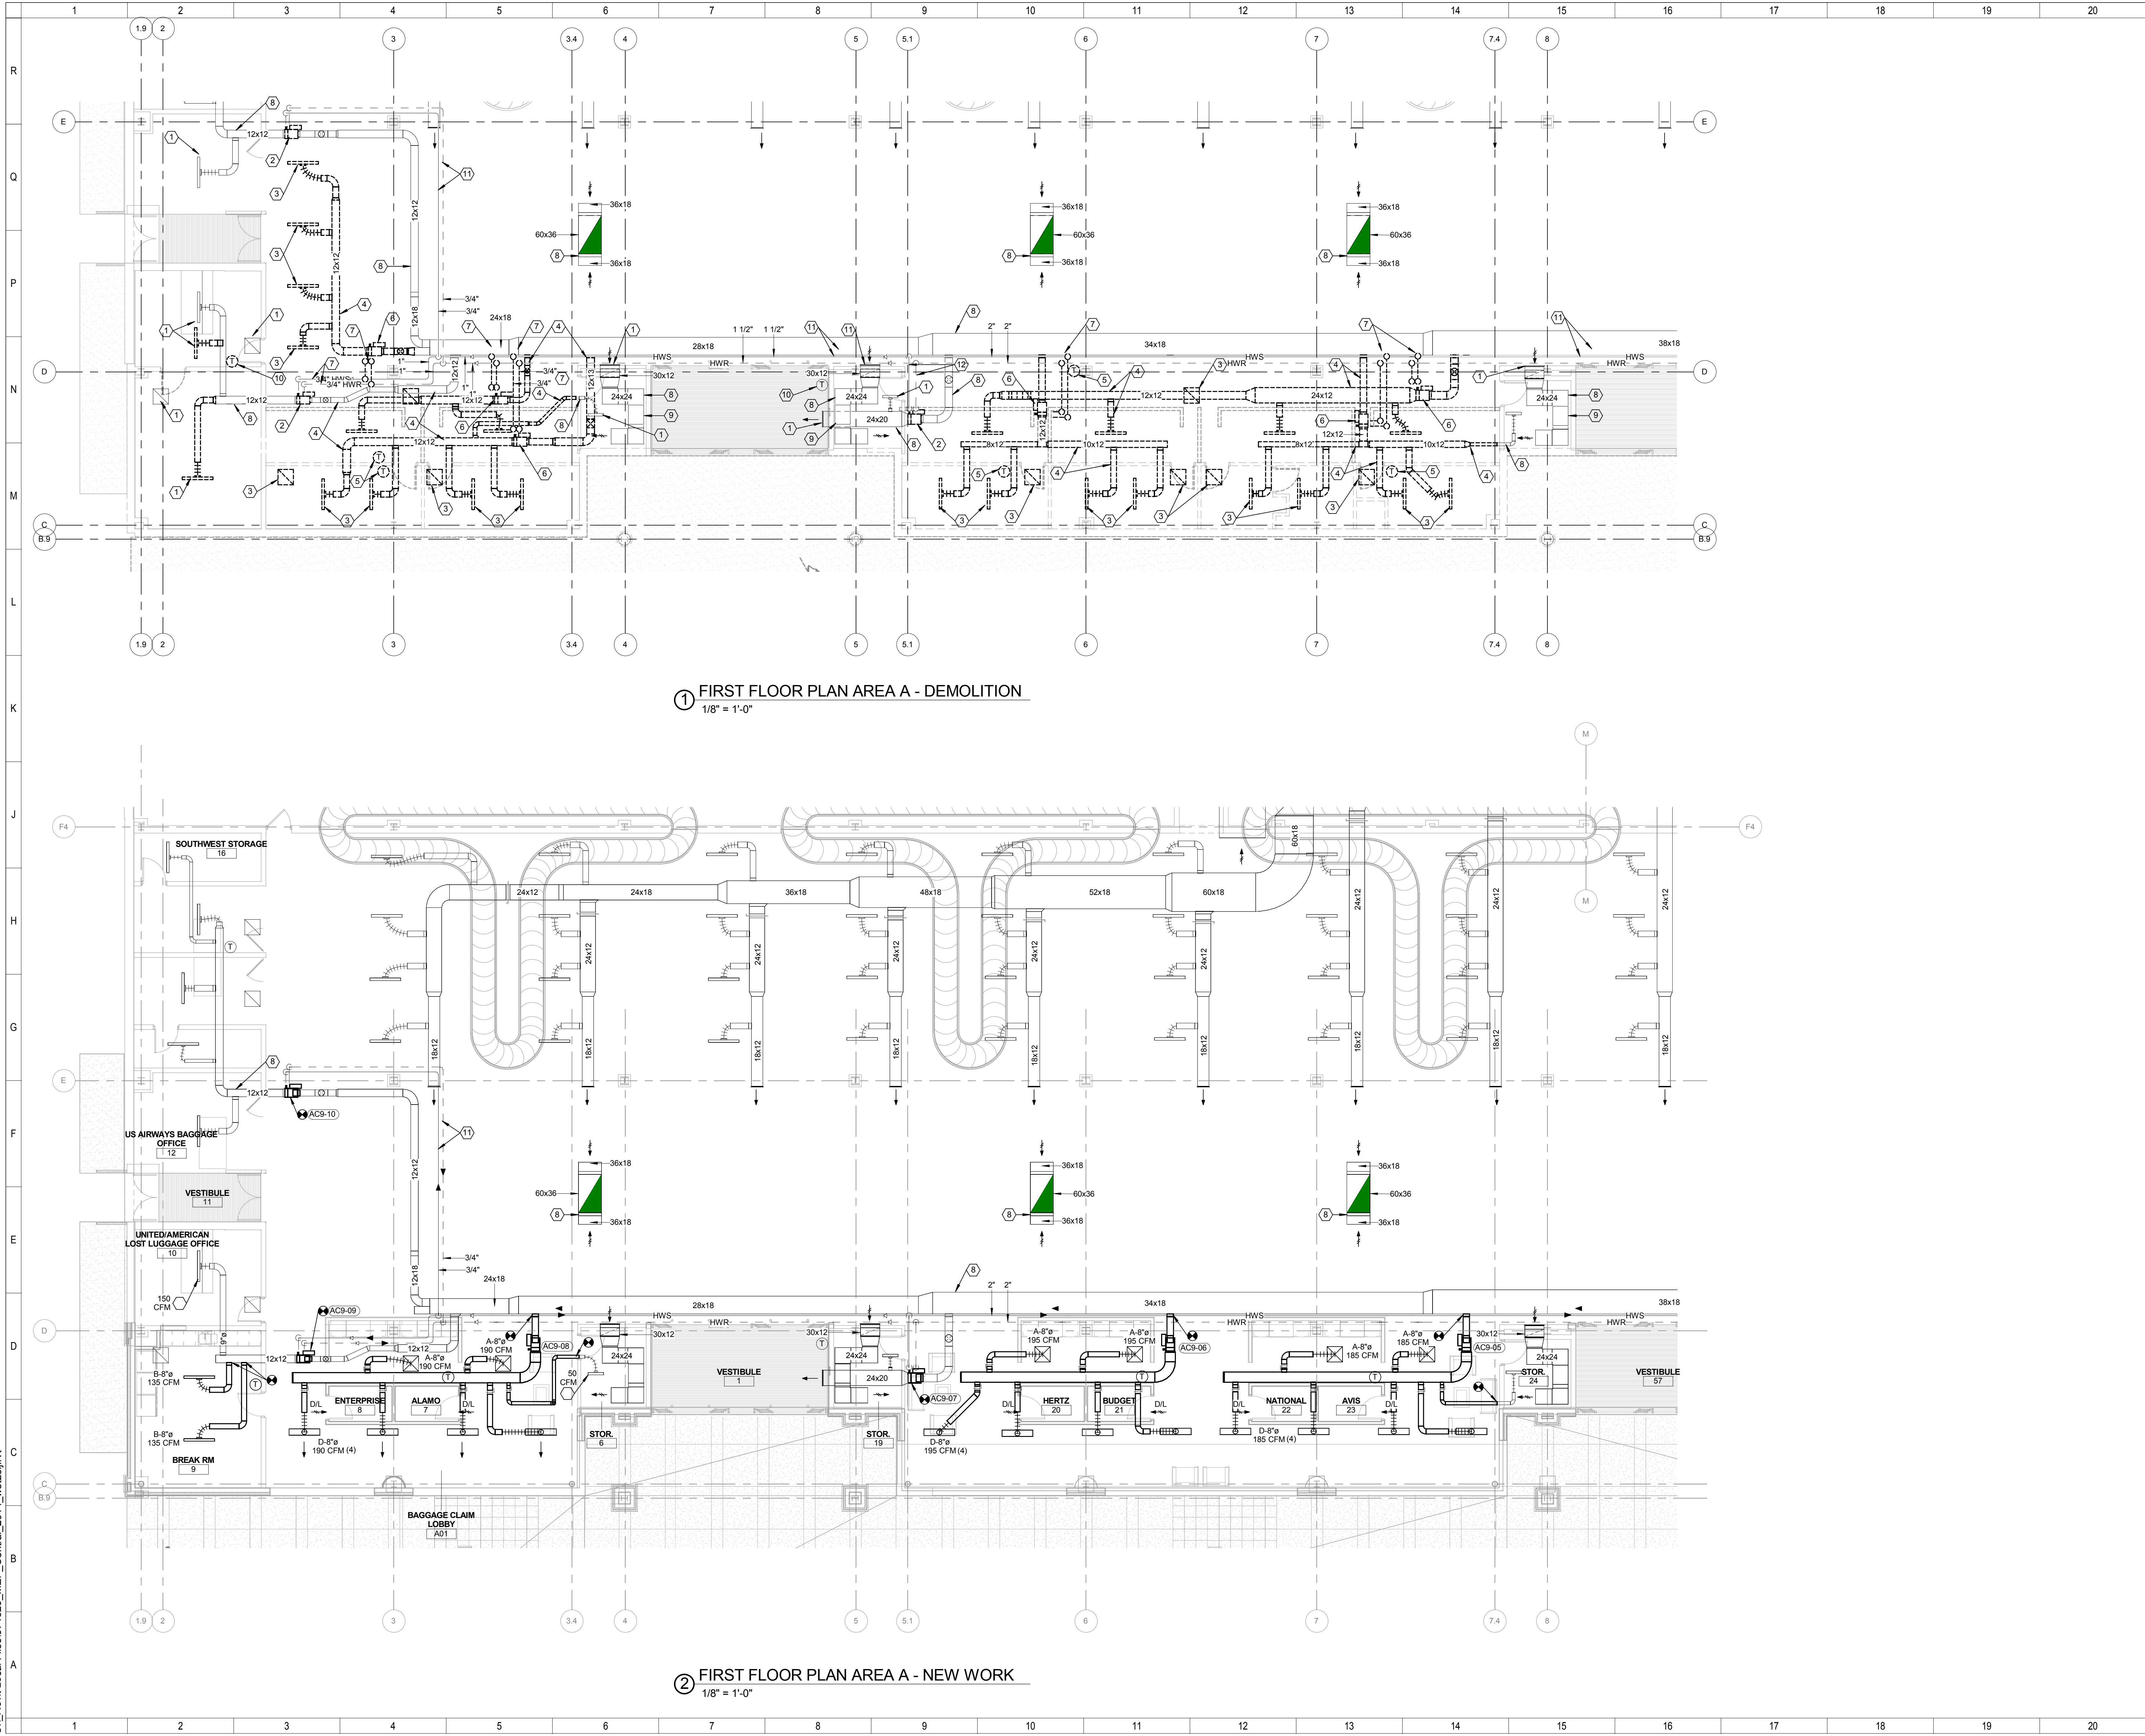

SHEET NOTES:

- EXISTING AIR DEVICE TO REMAIN.
- EXISTING TERMINAL UNIT TO REMAIN.
- EXISTING AIR DEVICE AND ASSOCIATED ACCESSORIES AND SUPPORTS TO BE REMOVED
- EXISTING DUCTWORK AND SUPPORTS TO BE REMOVED AS INDICATED.
- EXISTING THERMOSTAT AND ASSOCIATED CONTROL TUBING/WIRING TO BE REMOVED.
- EXISTING TERMINAL UNIT AND ASSOCIATED CONTROLS, WIRING, SUPPORTS AND REHEAT COIL PIPING TO BE REMOVED AS INDICATED.
- HOT WATER RUNOUT PIPING FOR EXISTING TERMINAL UNIT REHEAT COILS SHALL BE REMOVED BACK TO MAIN AND CAPPED.
- EXISTING DUCTWORK TO REMAIN.
- EXISTING EXHAUST FAN LOCATED WITHIN PLENUM SPACE TO REMAIN.
- EXISTING THERMOSTAT TO REMAIN.
- EXISTING HOT WATER SUPPLY AND RETURN PIPING TO REMAIN.

KEY PLAN:

No.	Revisions / Submissions	Date

LWC
INCORPORATED
434 East First Street Dayton, OH 45402 937.223.6500
4440 Garwood Place Richmond, IN 47374 765.966.3546

DAYTON INTERNATIONAL AIRPORT
3600 TERMINAL DRIVE
VANADALIA, OH 45377
(937) 454-8209


PHASE 1 - CANOPY RENOVATION
3600 TERMINAL DRIVE

DEMO AND NEW WORK PLAN - AREA "A"

PROGRESS DRAWING NOT FOR CONSTRUCTION 2/2/2015 5:01:08 PM	Comm. No. 14613.00 Drawn Author Checked Checker	Date 12-12-2014 Drawing No. H-101
--	--	---

© 2013 LWC, INCORPORATED

2/2/2015 5:01:21 PM
C:\Revit Local Files\074823_MEP_Central_2014_wetzel.rvt

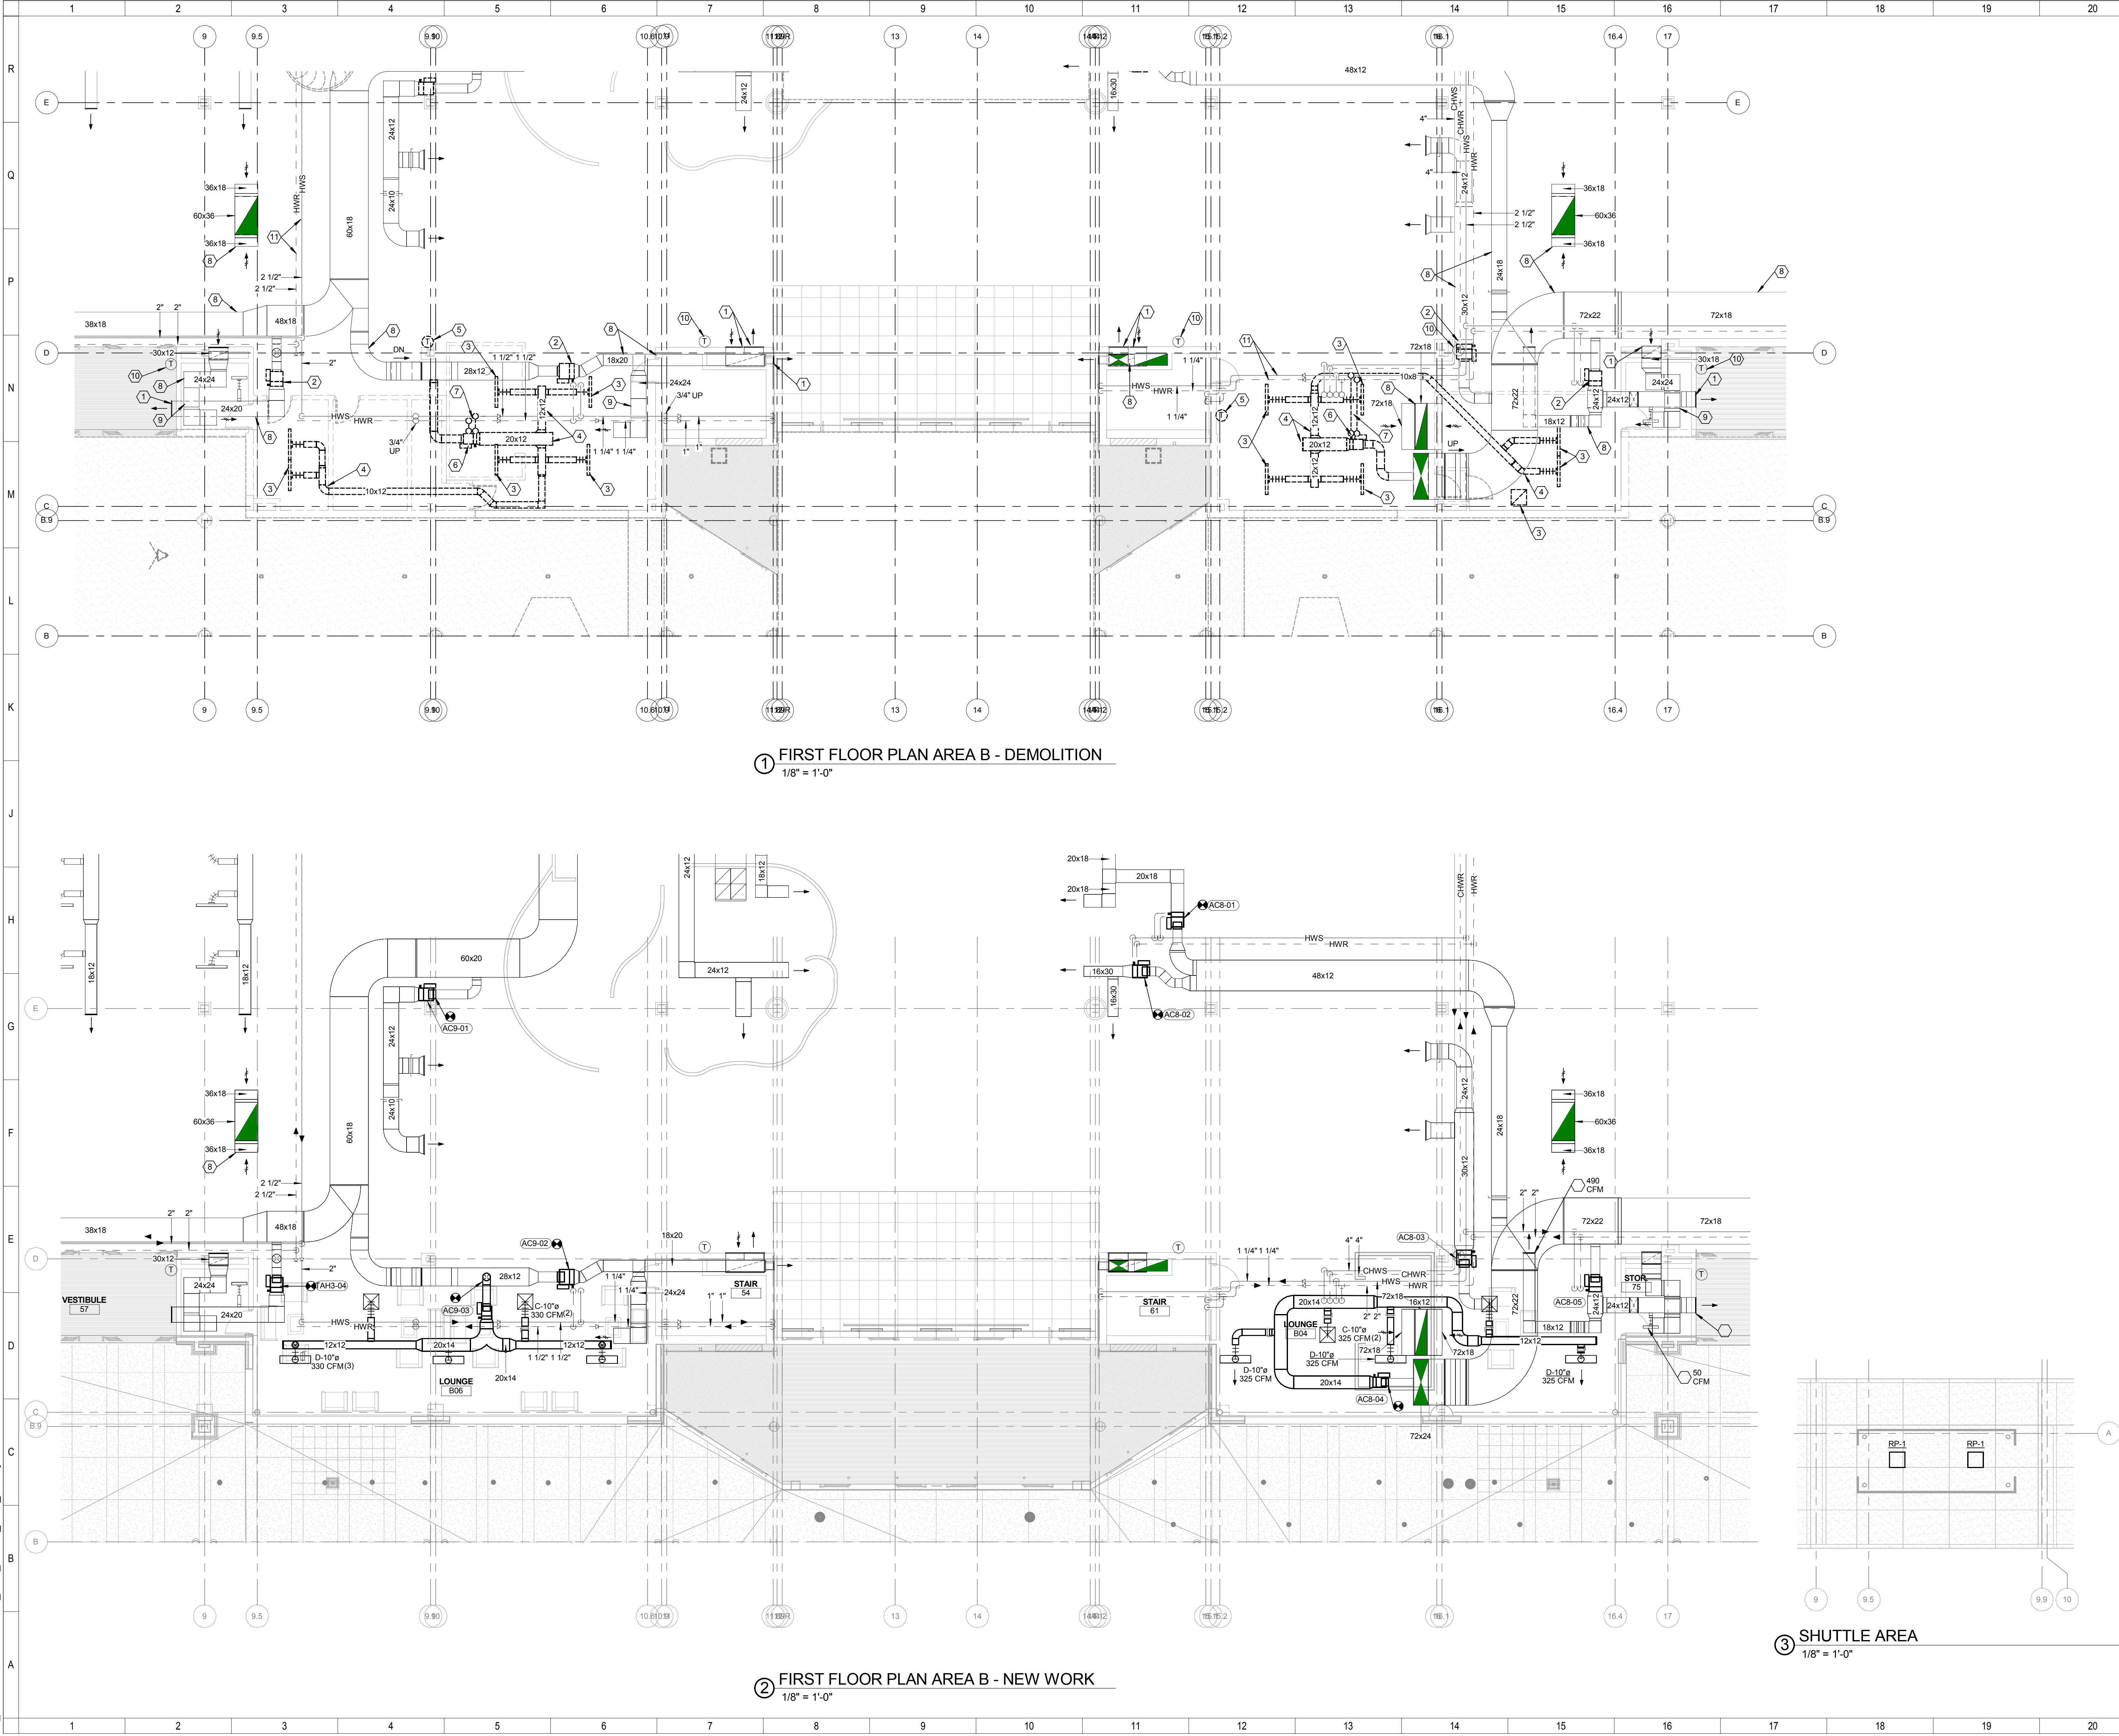

1 FIRST FLOOR PLAN AREA B - DEMOLITION
1/8" = 1'-0"


2 FIRST FLOOR PLAN AREA B - NEW WORK
1/8" = 1'-0"

3 SHUTTLE AREA
1/8" = 1'-0"

SHEET NOTES:

- 1 EXISTING AIR DEVICE TO REMAIN.
- 2 EXISTING TERMINAL UNIT TO REMAIN.
- 3 EXISTING AIR DEVICE AND ASSOCIATED ACCESSORIES AND SUPPORTS TO BE REMOVED
- 4 EXISTING DUCTWORK AND SUPPORTS TO BE REMOVED AS INDICATED.
- 5 EXISTING THERMOSTAT AND ASSOCIATED CONTROL TUBING/WIRING TO BE REMOVED.
- 6 EXISTING TERMINAL UNIT AND ASSOCIATED CONTROLS, WIRING, SUPPORTS AND REHEAT COIL PIPING TO BE REMOVED AS INDICATED.
- 7 HOT WATER RUNOUT PIPING FOR EXISTING TERMINAL UNIT REHEAT COILS SHALL BE REMOVED BACK TO MAIN AND CAPPED.
- 8 EXISTING DUCTWORK TO REMAIN.
- 9 EXISTING EXHAUST FAN LOCATED WITHIN PLENUM SPACE TO REMAIN.
- 10 EXISTING THERMOSTAT TO REMAIN.
- 11 EXISTING HOT WATER SUPPLY AND RETURN PIPING TO REMAIN.

KEY PLAN:

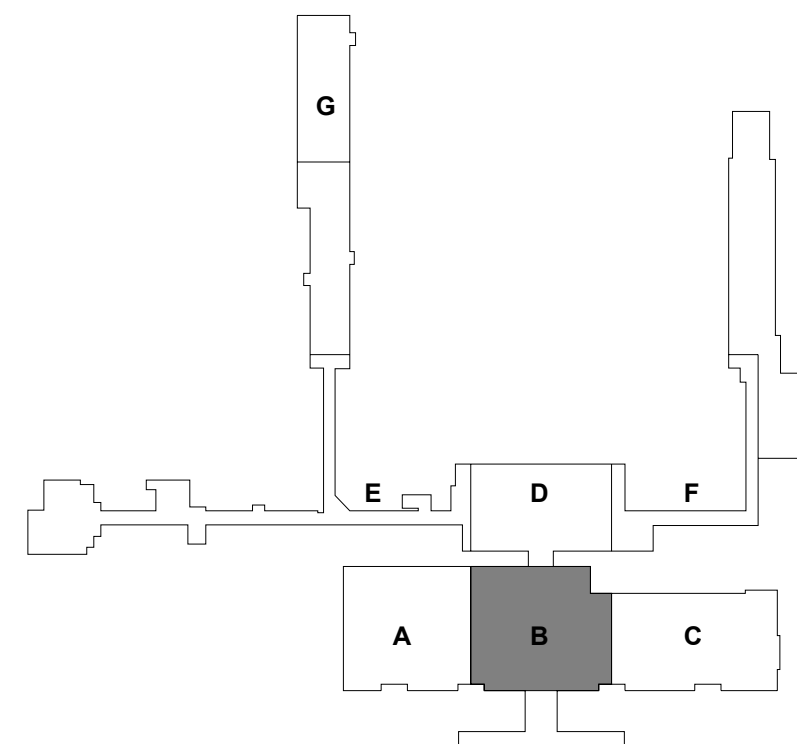

No.	Revisions / Submissions	Date
-----	-------------------------	------

LWC
INCORPORATED
434 East First Street Dayton, OH 45402 937.223.6500
4440 Garwood Place Richmond, IN 47374 765.966.3546


DAYTON INTERNATIONAL AIRPORT
3600 TERMINAL DRIVE
VANADALIA, OH 45377
(937) 454-8209

**PHASE 1 - CANOPY
RENOVATION**
3600 TERMINAL DRIVE

DEMO AND NEW WORK PLAN - AREA "B"

PROGRESS DRAWING NOT FOR CONSTRUCTION 2/2/2015 5:01:21 PM	Comm. No. 14613.00 Date 12-12-2014
Drawn Author Checked Checker	Drawn No. H-102 © 2013 LWC, INCORPORATED

2/2/2015 5:02:20 PM
C:\Revit Local Files\074823_MEP_Central_2014_wetzel.rvt

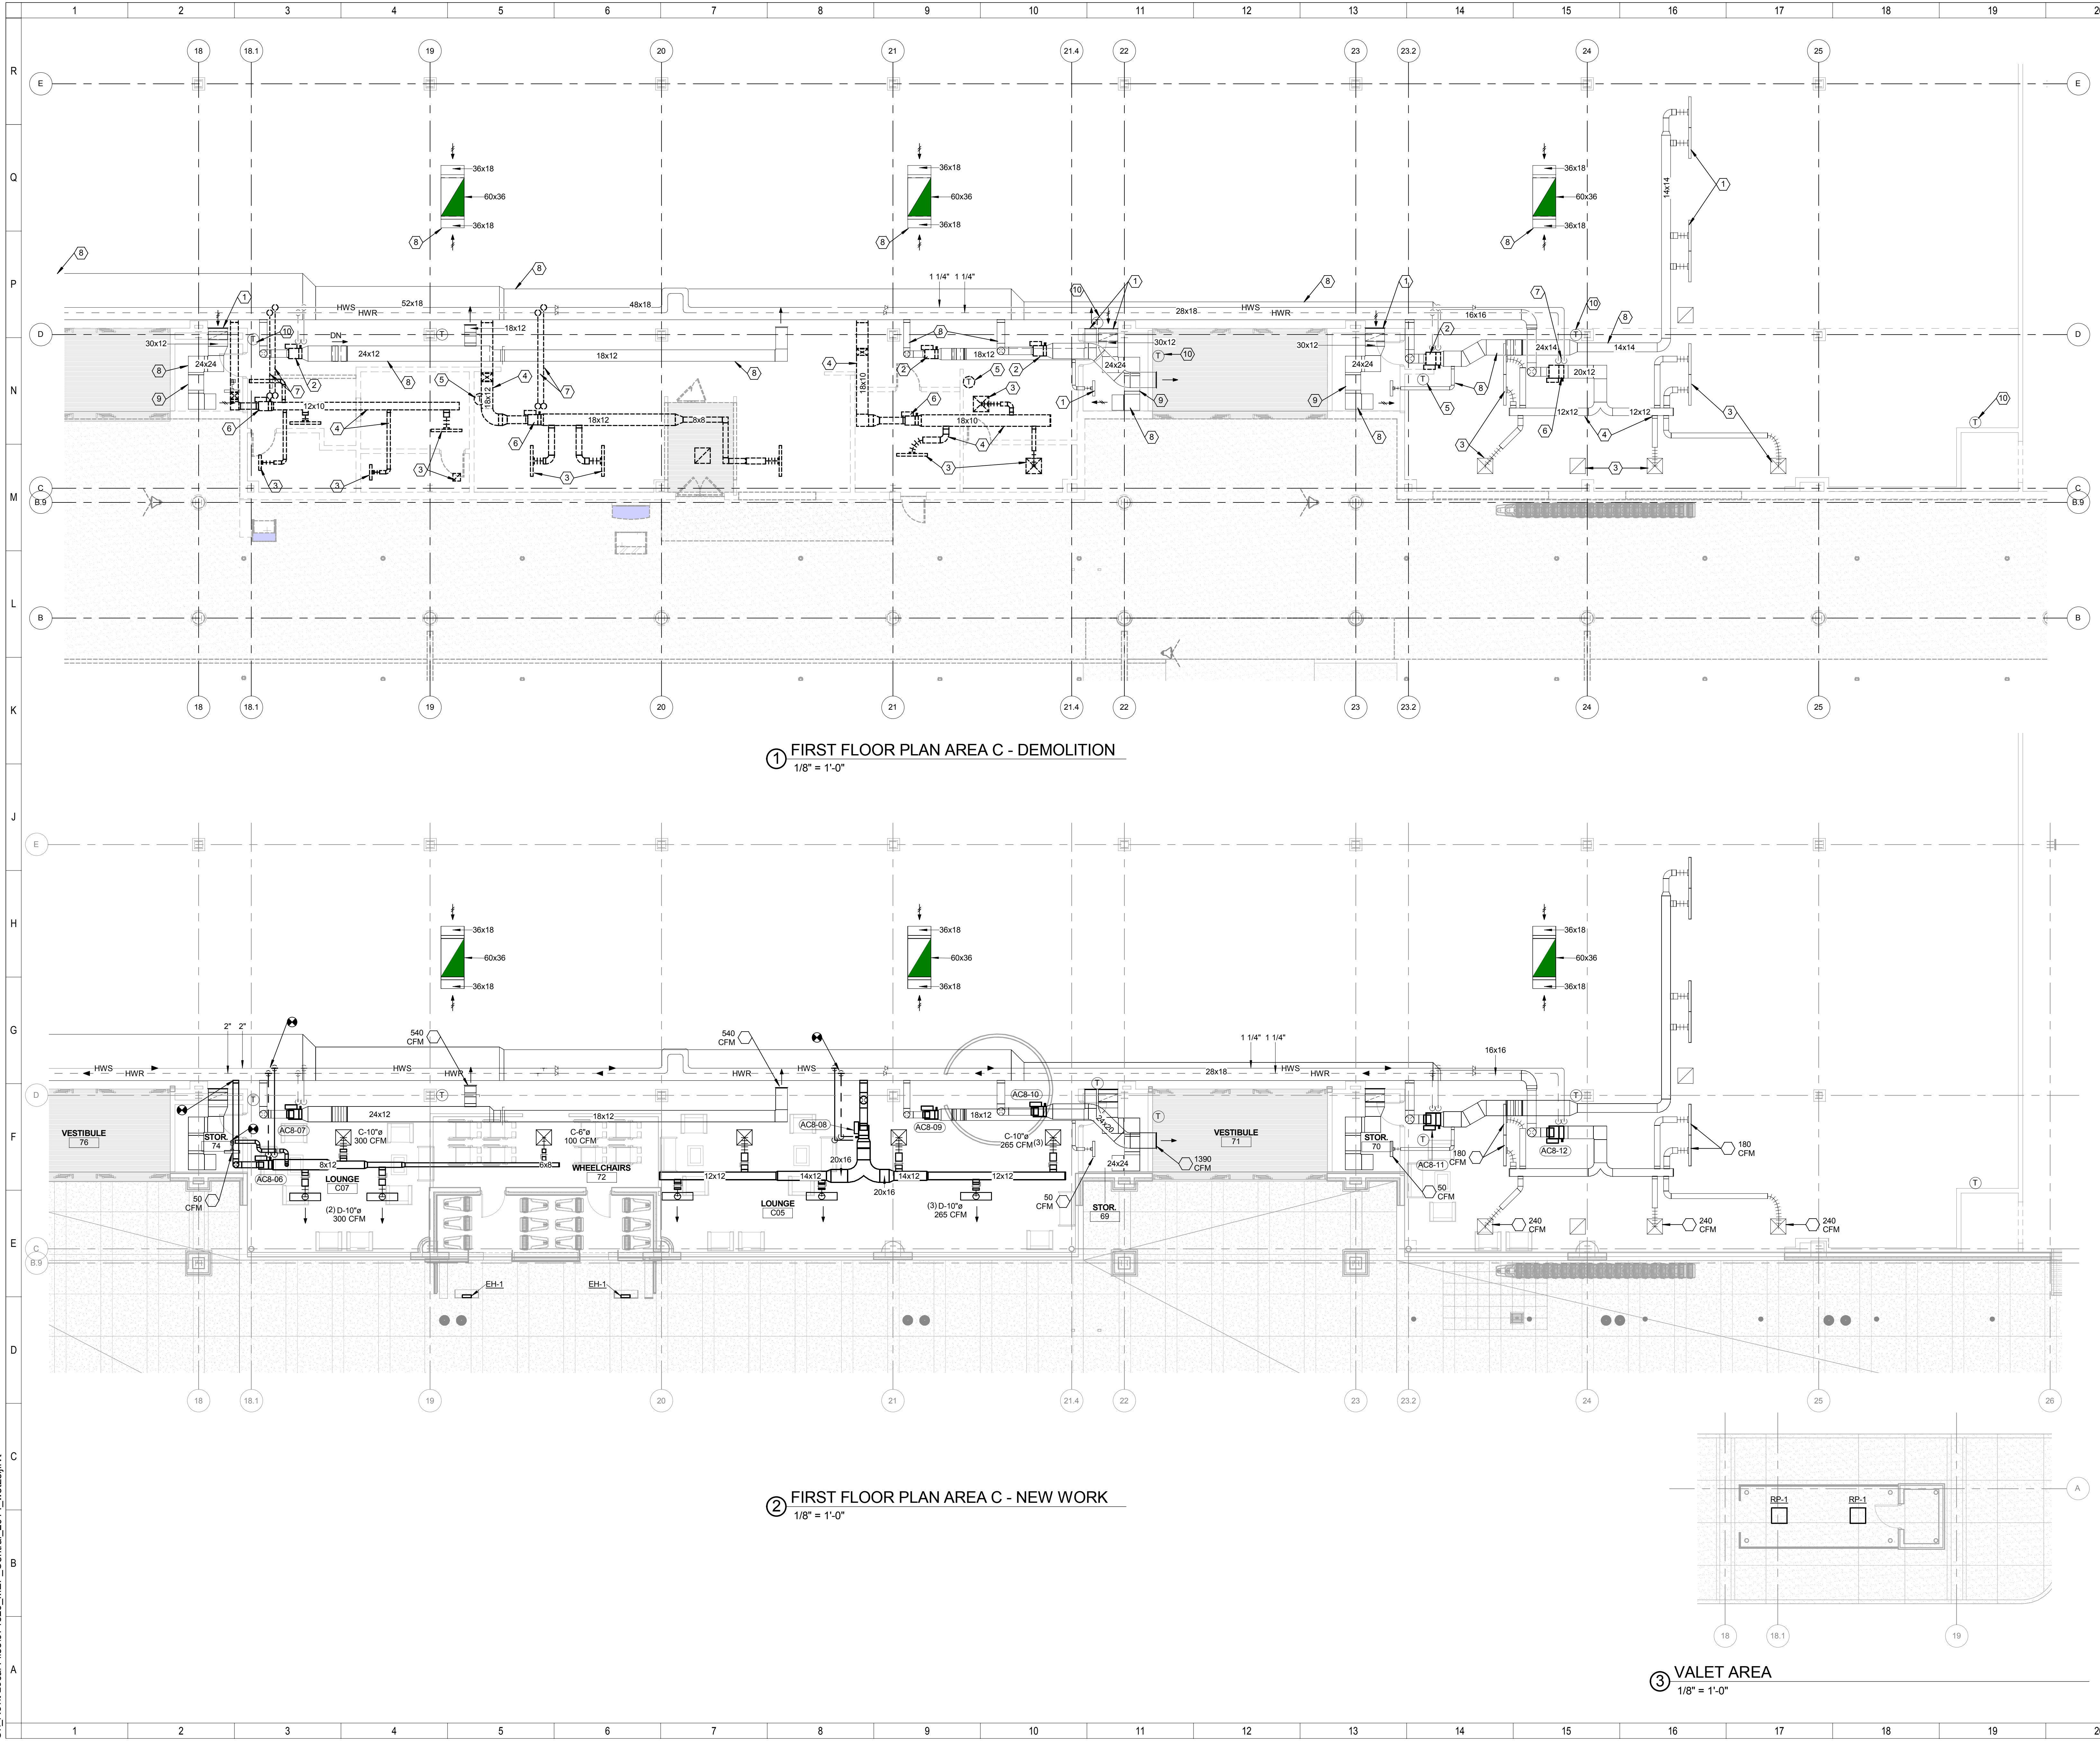


① FIRST FLOOR PLAN AREA C - DEMOLITION
1/8" = 1'-0"

② FIRST FLOOR PLAN AREA C - NEW WORK
1/8" = 1'-0"

③ VALET AREA
1/8" = 1'-0"

- SHEET NOTES:
- 1 EXISTING AIR DEVICE TO REMAIN.
 - 2 EXISTING TERMINAL UNIT TO REMAIN.
 - 3 EXISTING AIR DEVICE AND ASSOCIATED ACCESSORIES AND SUPPORTS TO BE REMOVED
 - 4 EXISTING DUCTWORK AND SUPPORTS TO BE REMOVED AS INDICATED.
 - 5 EXISTING THERMOSTAT AND ASSOCIATED CONTROL TUBING/WIRING TO BE REMOVED.
 - 6 EXISTING TERMINAL UNIT AND ASSOCIATED CONTROLS, WIRING, SUPPORTS AND REHEAT COIL PIPING TO BE REMOVED AS INDICATED.
 - 7 HOT WATER RUNOUT PIPING FOR EXISTING TERMINAL UNIT REHEAT COILS SHALL BE REMOVED BACK TO MAIN AND CAPPED.
 - 8 EXISTING DUCTWORK TO REMAIN.
 - 9 EXISTING EXHAUST FAN LOCATED WITHIN PLENUM SPACE TO REMAIN.
 - 10 EXISTING THERMOSTAT TO REMAIN.
 - 11 EXISTING HOT WATER SUPPLY AND RETURN PIPING TO REMAIN.

KEY PLAN:

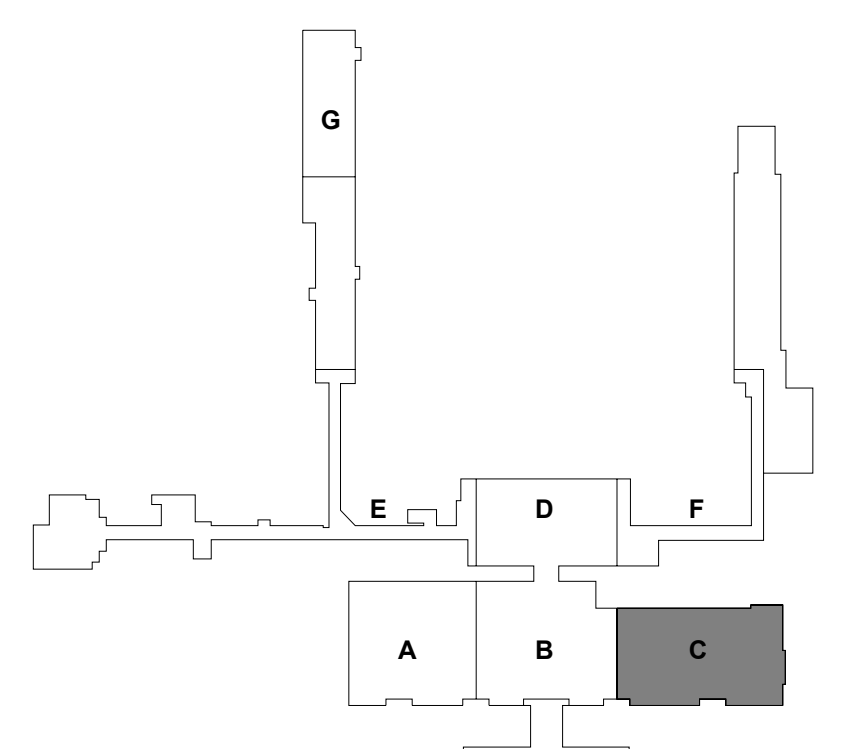

No.	Revisions / Submissions	Date
-----	-------------------------	------

LWC
INCORPORATED
434 East First Street Dayton, OH 45402 937.223.6500
4440 Garwood Place Richmond, IN 47374 765.966.3546

DAYTON INTERNATIONAL AIRPORT
3600 TERMINAL DRIVE
VANADALIA, OH 45377
(937) 454-8209


**PHASE 1 - CANOPY
RENOVATION**
3600 TERMINAL DRIVE

DEMO AND NEW WORK PLAN - AREA "C"

PROGRESS DRAWING NOT FOR CONSTRUCTION 2/2/2015 5:02:20 PM	Comm. No.	14613.00	Date	12-12-2014
	Drawn	Author	Drawn No.	
	Checked	Checker		
	H-103			
© 2013 LWC, INCORPORATED				

2/2/2015 5:02:27 PM

C:\Revit Local Files\074823_MEP_Central_2014_wetzel\nt

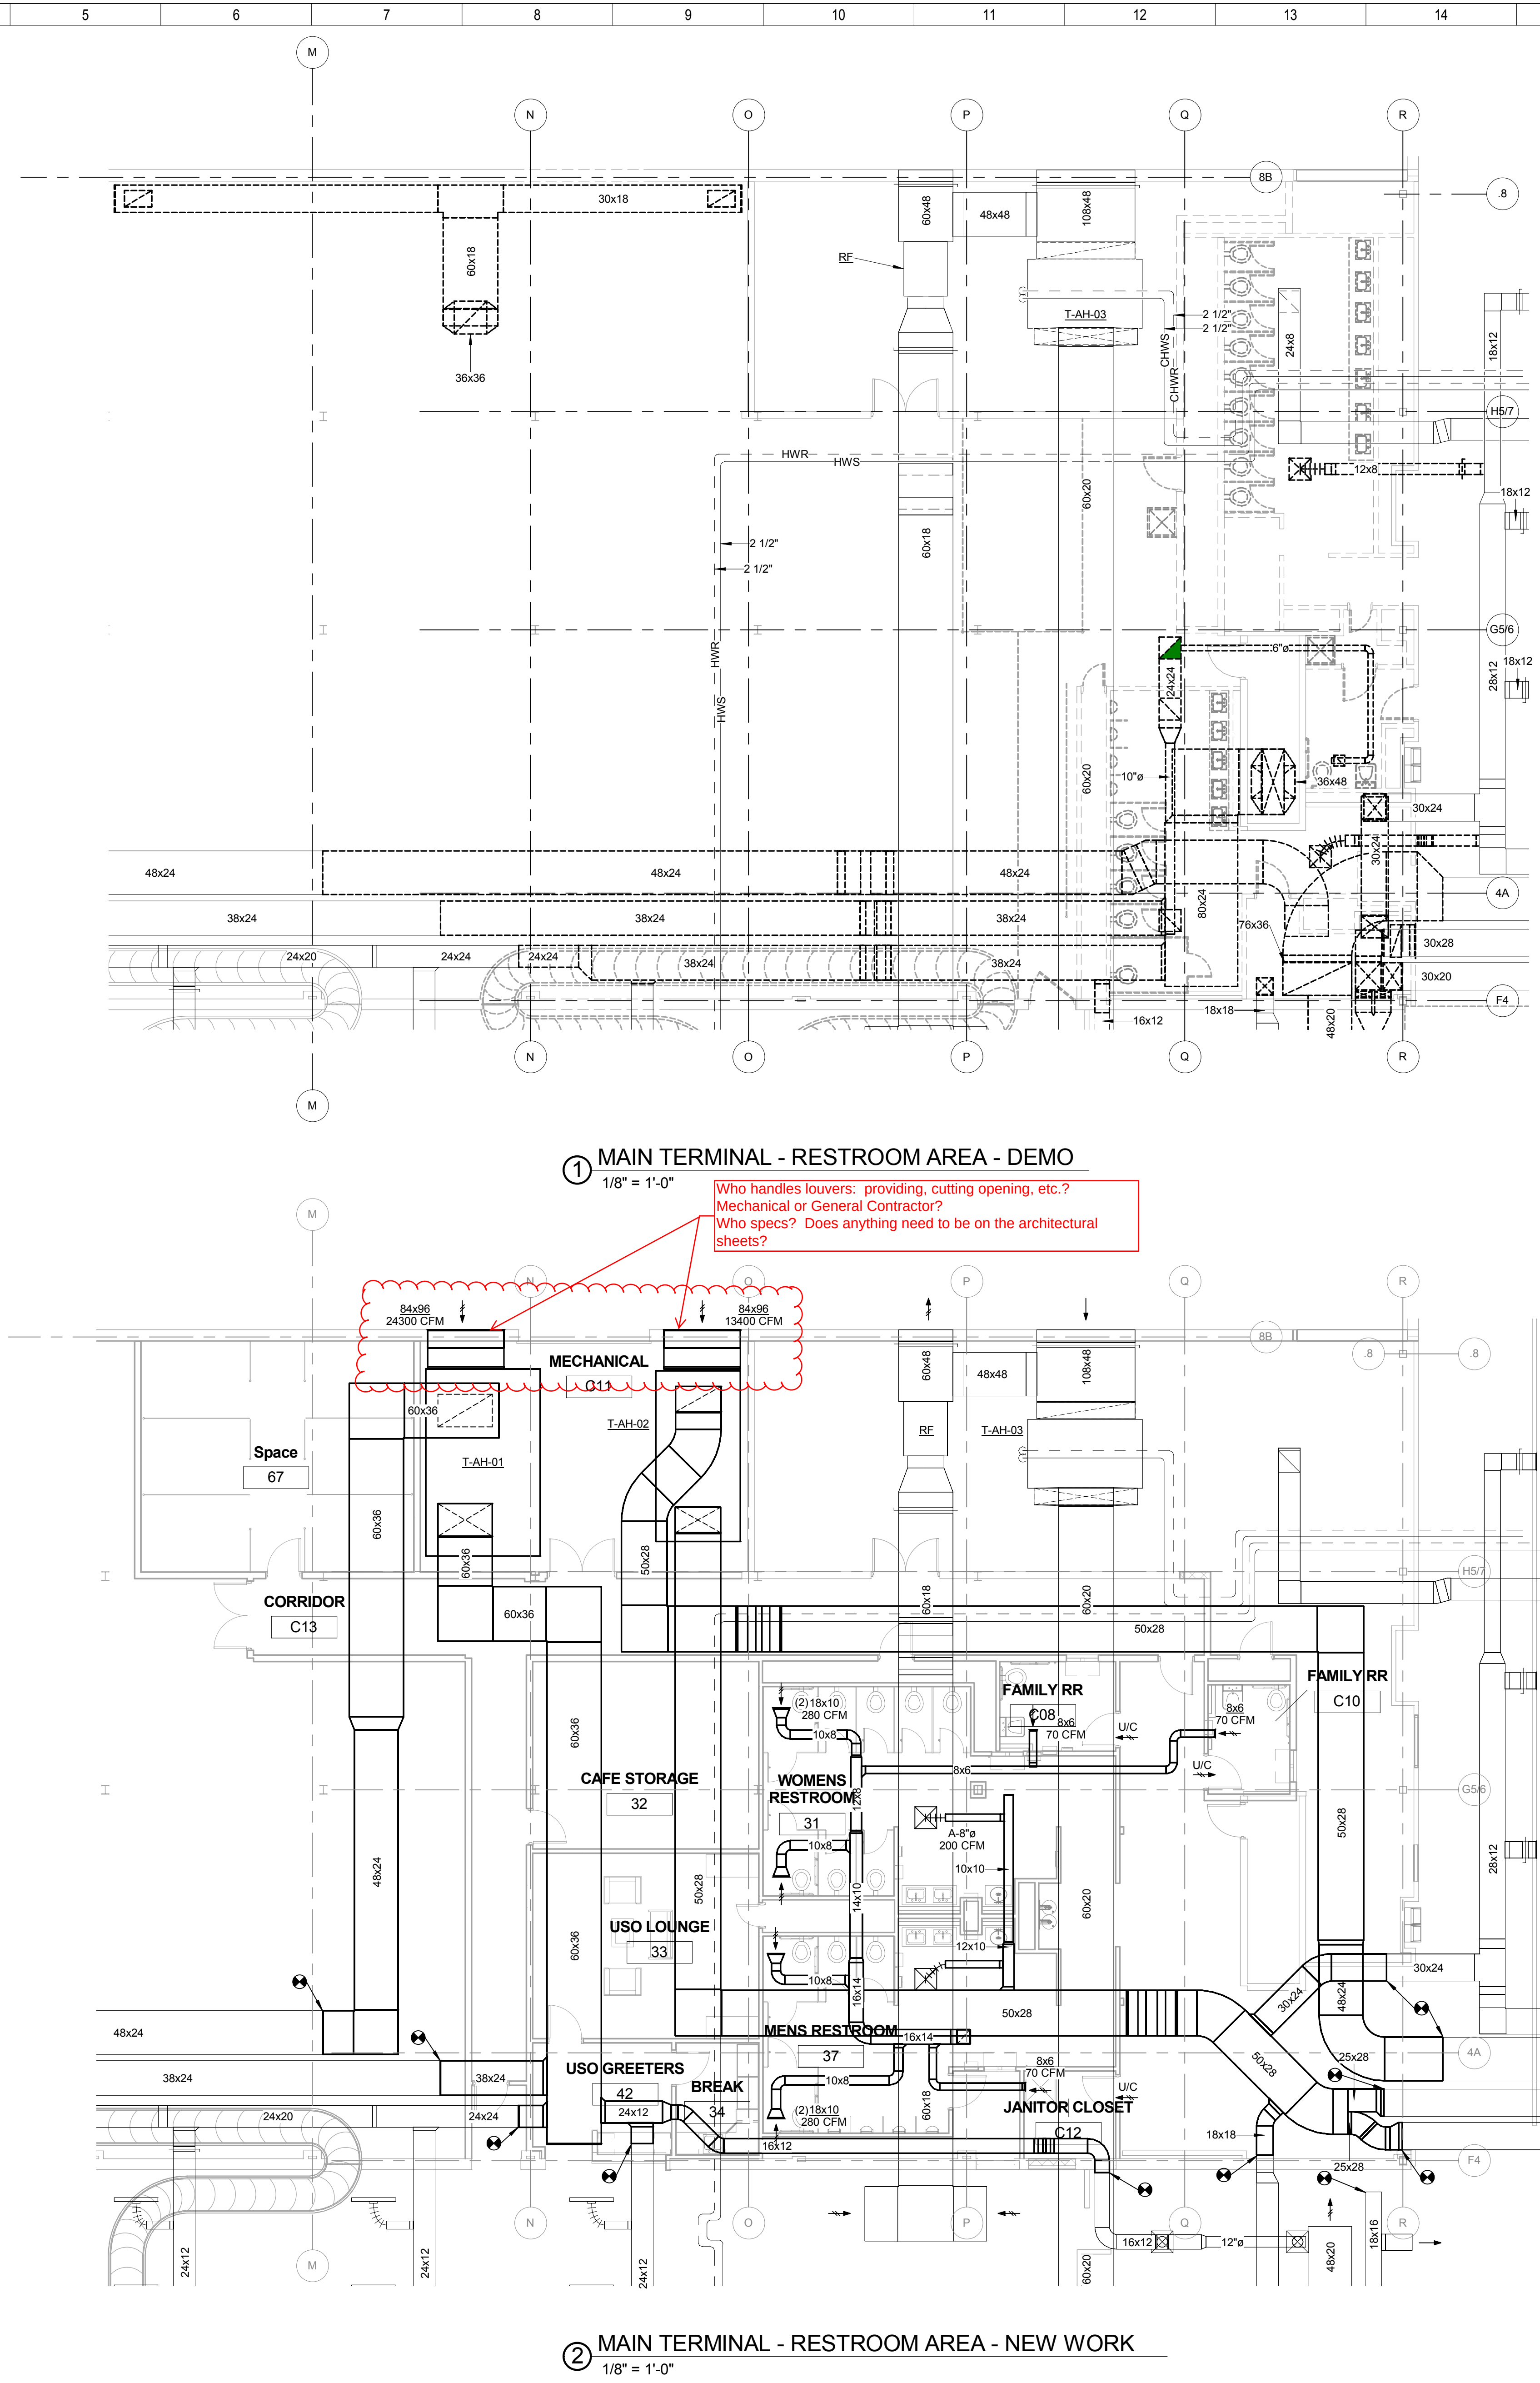

SHEET NOTES:

KEY PLAN:

No. Revisions / Submissions Date

LWC
INCORPORATED
434 East First Street Dayton, OH 45402 937.223.6500
4440 Garwood Place Richmond, IN 47374 765.966.3546

DAYTON INTERNATIONAL AIRPORT
3600 TERMINAL DRIVE
VANADALIA, OH 45377
(937) 454-8209

**PHASE 1 - CANOPY
RENOVATION**
3600 TERMINAL DRIVE

DEMO AND NEW WORK PLAN - RESTROOMS

PROGRESS DRAWING NOT FOR CONSTRUCTION 2/2/2015 5:02:27 PM	Comm. No.	Date
	14613.00	12-12-2014
	Drawn	Author
	Checked	Checker
H-104		
© 2013 LWC, INCORPORATED		